

FlexRight™ - Quick Start - Installation Instructions



Save energy - improve airflow - eliminate kinks and restrictions - form 90-degree flexible duct elbows – sizes 4” - 16”
Install FlexRight at: Diffusers - Grilles - Registers - Duct take-offs / taps - HVAC equipment round inlets and outlets.

990 Security Row
Richardson, TX 75081
(972) 699-1030
www.titus-hvac.com

1. Connect flexible duct inner core to air device per flexible duct manufacturer's installation instructions.
2. Pull flexible duct insulation and outer jacket over core.
3. Thread cable ties through both FlexRight saddle bands. (Fig #1)
4. Position FlexRight durable elbow support under flexible duct to form 90-degree elbow. (Fig #2)
5. Using cable tie tensioning tool, tighten cable tie around neck of air device to secure FlexRight.
6. Fasten second cable tie loosely around flexible duct. Do not over-tighten and crush flexible duct.
7. Cut-off and discard excess from both cable tie ends.
8. Alternate installation. (Fig #3)

Ask your Titus Rep about another innovative product:

FlexaBoot™

Lightweight acoustical sound boot for return air grilles and diffusers. Replaces sheet metal return boots.

- Dramatic Cost Savings
- Lightweight
- Easy to Handle
- Flexible Installation

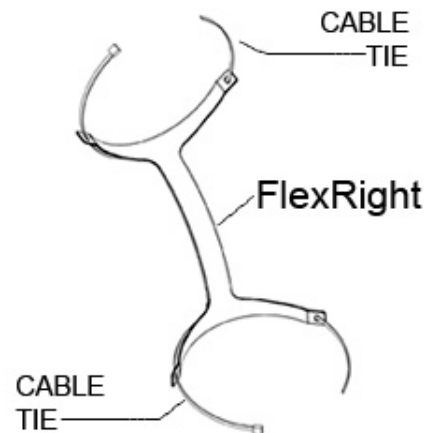


FIG # 1

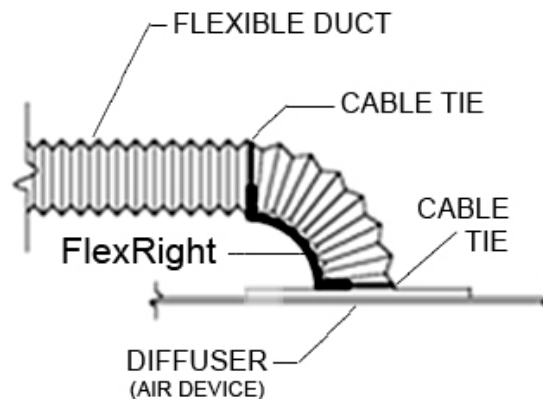


FIG # 2

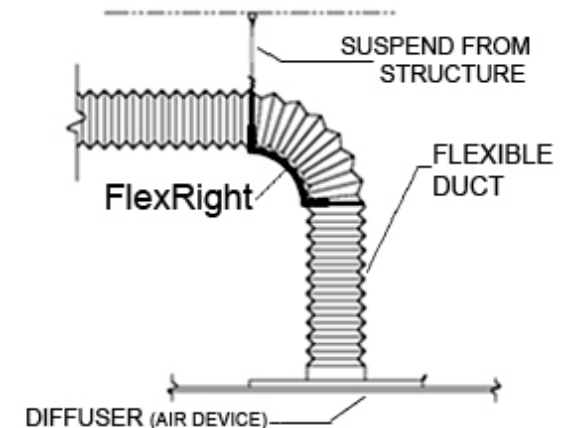


FIG # 3