

Innovative Simple Direct


Two Units With One Thermostat? No Problem.

TK-400™ UNIVERSAL TWINNING/PARALLELING KIT

The TK-400™ is designed to allow a single thermostat to control two separate HVAC units. The TK-400 can also be expanded to control a total of four HVAC units. The twinning/paralleling panel can be used with both heat / cool and heat pump systems.

Reasons For Buying From Jackson Systems

- Innovative Control Products
- Simple to Install
- Direct to Contractors
- Great Technical Support
- Free Shipping
- Orders Shipped The Same Day
- Formal Quotes Provided Within Minutes
- Design Assistance Provided
- Online Ordering
- 5 Year Warranty

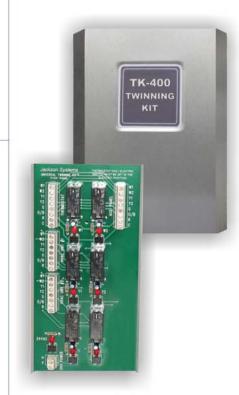



Jackson Systems, LLC

Toll-Free: 888.652.9663 Fax: 317.227.1034 www.jacksonsystems.com

TK-400™ Universal Twinning Kit™

GENERAL

The Jackson Systems TK-400 Universal Twinning Kit™ is designed to allow a single thermostat to control two separate HVAC units. The TK-400 can also be expanded to control two additional HVAC units. The Universal Twinning Kit™ can be used with single stage (1 Heat / 1 Cool), multi-stage (2 Heat / 2 Cool) and heat pump (3 Heat / 2 Cool) equipment.

SEQUENCE OF OPERATION

The TK-400 is designed to control each HVAC unit collectively based on the thermostat input. For example, if the thermostat calls for first stage cooling, 'Y1' and 'G' on both HVAC units will be energized at the same time.

INSTALLATION

To install the panel, first slide the PC board out of its base and screw the base to a flat surface in a location that allows easy access to wiring. Reinstall the PC board by carefully centering it over the base and snapping it into the track grooves.


Connect a separate 24 Vac, 40VA transformer to the twinning terminals marked 'H' and 'X'.

Only standard 18 gauge thermostat wire is required. The thermostat and HVAC units can be located up to 300 feet from the twinning kit.

The thermostat must be equipment compatible.

(heat / cool stats for heat / cool equipment and heat pump stats for heat pumps)

Wire the thermostat to the terminals marked 'STAT'. Thermostat fan operation must be set for electric.

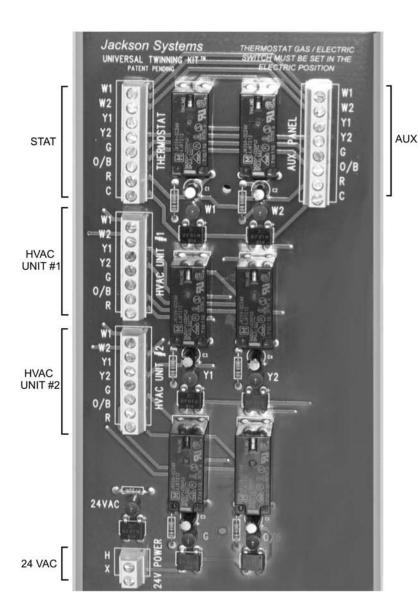

Wire appropriate HVAC unit to terminals marked 'HVAC UNIT #1' and 'HVAC UNIT #2'.

Always install backdraft dampers in the separate discharge air ducts or separate return air ducts of both air handling units



Jackson Systems, LLC

Toll-Free: 888.652.9663 Fax: 317.227.1034 www.jacksonsystems.com